Taylex Product Catalogue





Proudly Australian owned and made since 1969, Taylex manufacture a range of products for Wastewater, Rainwater and Stormwater.





Contents

Advanced Secondary Systems	4
Advanced Primary Septic Systems	13
Pump Stations	18
Concrete Rainwater Tanks	20
Concrete, Composite & Gatic Access Covers and Risers	24
Hole Coring	29
Electrical Equipment	33
Pumps	38
Piston Blowers, Diffusers & Blower Retro Kits	42
Filters	47
Irrigation	50
Servicing	57
Sales Support Material	63

Advanced Secondary Systems


From raw sewage to clean, clear, safe water to re-use on site.



What's New With Taylex?

Advanced Secondary System with Nutrient Reduction

The New Taylex ABS **Nutrient Reduction Systems**

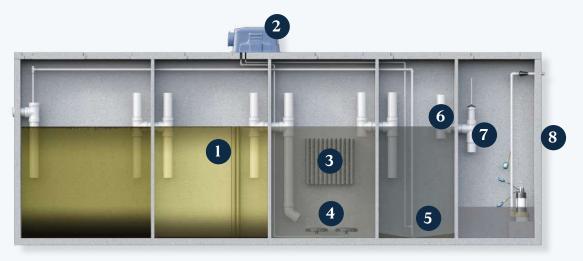

New Developments in the Taylex ABSNR / +P

- 1. Retention Bio Mass
- 2. Larger 120L Blower
- 3. Larger Aeration Bio Mass
- 4. Dual-Disk Diffusers
- 5. Enhanced Recirculation + Sludge Return Process
- 6. Taylex Filter Control (TFC) Patent Pending
- 7. Precise Chlorination
- 8. Phosphorous Removal Filter (+P Models)

Best in Class

- Largest Daily Operating Capacity 2000L*
- Highest Combined Nutrient Reduction (Natural Process)
- Concrete and Lightweight Options
- Industry's Largest Emergency Storage
- Multiple Invert & Riser Options
- **Enhanced Servicing Efficiency**
- Efficient to Install
- Superior Structural Integrity (Monolithic Moulding)

*For domestic single tank systems.


Taylex is committed to protecting the environment and human health.



E.coli Reduction 99.99% TSS Reduction 99% **BOD Reduction 99%** Up to 164% Combined Nutrient Reductions

- Odourless
- **Longer Pump Out** Intervals

ABS, ABSNR + P Concrete Tank Sizes

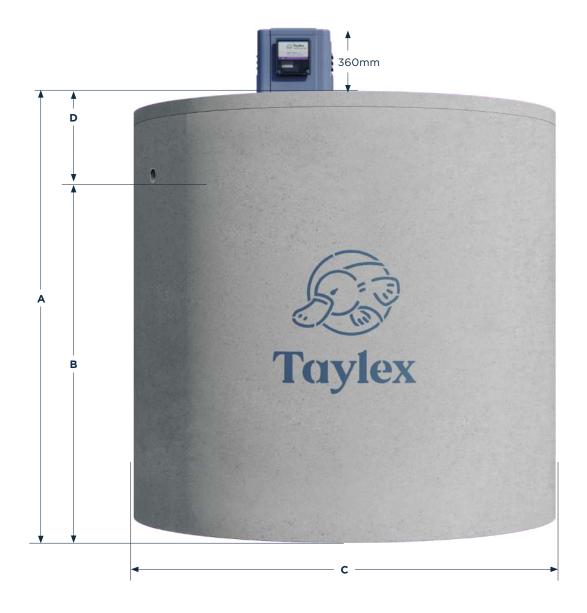

TANK SIZE	WEIGHT	A TOTAL HEIGHT OF TANK	B BOTTOM OF TANK TO BOTTOM OF INLET	C TOTAL WIDTH OF TANK	D TOP OF TANK TO BOTTOM OF INLET
STANDARD	6.25T	2,300mm	1,530mm	2,425mm	770mm
TALL 400	8T	2,700mm	1,530mm	2,425mm	1,170mm
TALL 600	8T	2,900mm	1,530mm	2,425mm	1,370mm

^{*}Taylex Offers A Range of invert levels for the ABS2000 and ABS1500 systems to offer versatile solutions to your block's requirements

ABS (1500 & 2000) Concrete Tanks δ 1,500L p/day β 10 Person δ 2,000L p/day β 13 Person

Advanced Secondary System

ABS STANDARD - 6.25T

ABS TALL 400 - 8T	
ABS-38M	ABS 1500 & 2000 with 38m Head Pump
ABS-26M	ABS 1500 & 2000 with 26m Head Pump
ABS-9M	ABS 1500 & 2000 with 9m Head Pump

ABS 1500 & 2000 Tall 400 with 26m Head Pump

ABS 1500 & 2000 Tall 400 with 38m Head Pump

ABS TALL 600 - 8T

ABS400-26M

ABS400-38M

ABS600-9M	ABS 1500 & 2000 Tall 600 with 9m Head Pump
ABS600-26M	ABS 1500 & 2000 Tall 600 with 26m Head Pump
ABS600-38M	ABS 1500 & 2000 Tall 600 with 38m Head Pump



ABSNR (1350 & 2000) Concrete Tanks $^{\lozenge\,1,350L\,p/day}_{\lozenge\,2,000L\,p/day}$ $^{\lozenge\,9\,Person}_{\lozenge\,2,000L\,p/day}$

Advanced Secondary System with Nutrient Reduction

ABSNR STANDARD - 6.25T

ABSNR-9M	ABSNR 1350 & 2000 with 9m Head Pump
ABSNR-26M	ABSNR 1350 & 2000 with 26m Head Pump
ABSNR-38M	ABSNR 1350 & 2000 with 38m Head Pump

ABSNR TALL 400 - 8T

ABSNR400-9M	ABSNR 1350 & 2000 Tall 400 with 9m Head Pump
ABSNR400-26M	ABSNR 1350 & 2000 Tall 400 with 26m Head Pump
ABSNR400-38M	ABSNR 1350 & 2000 Tall 400 with 38m Head Pump

ABSNR TALL 600 - 8T

ABSNR600-9M	ABSNR 1350 & 2000 Tall 600 with 9m Head Pump
ABSNR600-26M	ABSNR 1350 & 2000 Tall 600 with 26m Head Pump
ABSNR600-38M	ABSNR 1350 & 2000 Tall 600 with 38m Head Pump

Phosphorous Removal Filter (P-Filter)

Phosphorus Removal used in addition with Advanced Secondary System with Nutrient Reduction


PHOSPHORUS REMOVAL FILTER

ABS+P-Filter	P Filter Assembly to Suit ABSNR Models

PABS, PABSNR + P Concrete Tank Sizes

Advanced Secondary System



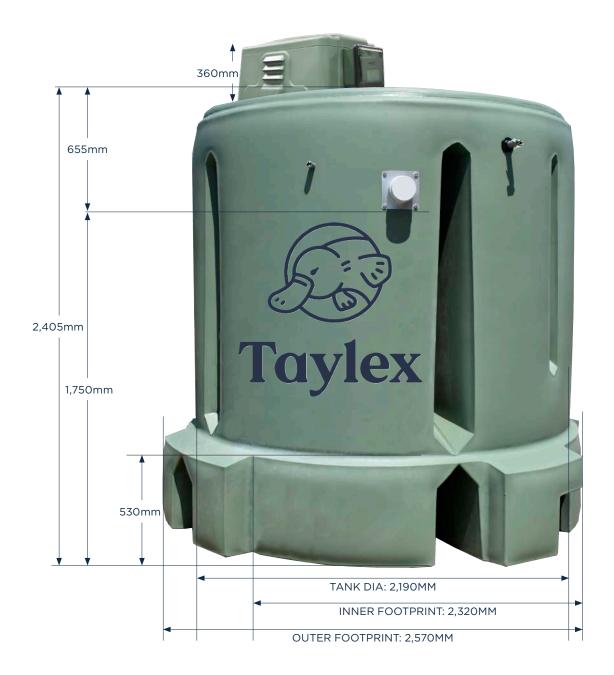

PABS (1500 & 2000) Poly Tanks

 \lozenge 1,500L p/day \lozenge 10 Person \lozenge 2,000L p/day \lozenge 13 Person

Advanced Secondary System

ABS STANDARD - 600KG

PABS-9M	PABS 1500 & 2000 with 9m Head Pump
PABS-26M	PABS 1500 & 2000 with 26m Head Pump
PABS-38M	PABS 1500 & 2000 with 38m Head Pump

PABSNR (1350 & 2000) Poly Tanks

 \lozenge 1,350L p/day \lozenge 9 Person \lozenge 2,000L p/day \lozenge 13 Person

Advanced Secondary System with Nutrient Reduction

PABSNR - 600KG

PABSNR-9M	PABSNR with 9m Head Pump
PABSNR-26M	PABSNR with 26m Head Pump
PABSNR-38M	PABSNR with 38m Head Pump

Phosphorous Removal Filter (P-Filter)

Phosphorus Removal used in addition with Advanced Secondary System with Nutrient Reduction

PHOSPHORUS REMOVAL FILTER

ABS+P-Filter	P Filter Assembly to Suit PABSNR Models
7.20	The first field from the first field from the first field from the first field from the first fr

ABS 5000 + 4200 Concrete Tanks

\$5,000L/4,200L p/day \$\,10+ Person

Advanced Secondary Treatment System



ABS 5000 - 8T EACH TANK (NOT AVAILABLE IN QUEENSLAND)

ABS5000-26M-CC

ABS5000 with 26m Head Pump & Composite Access Covers

ABS 4200 - 8T EACH TANK (AVAILABLE IN ALL STATES)

ABS4200-26M-CC

ABS4200 with 26m Head Pump & Composite Access Covers

Concrete Lids



STANDARD ABS LID - 800KG

ABSLIDCOMPLETE

With concrete access covers



COMPOSITE LID - 800KG

ABSLID-COMPOSITE LIDS

With composite access covers

PART NO. - CC

Simply add CC to any ABS System Part No. (eg. ABS-9m-CC, ABS500-26m-CC)

ABS Riser Rings


*All Risers Must be transported with an ABS Lid Bare



ABSRR600	600mm Riser - 781kg*
ABSRR800	800mm Riser - 1,040kg*
ABSRR1000	1000mm Riser - 1,300kg*
*ABSLIDBARE	ABS LID (No Access Covers)


Advanced Primary Septic Systems

High quality, reliable Primary Treatment solutions.

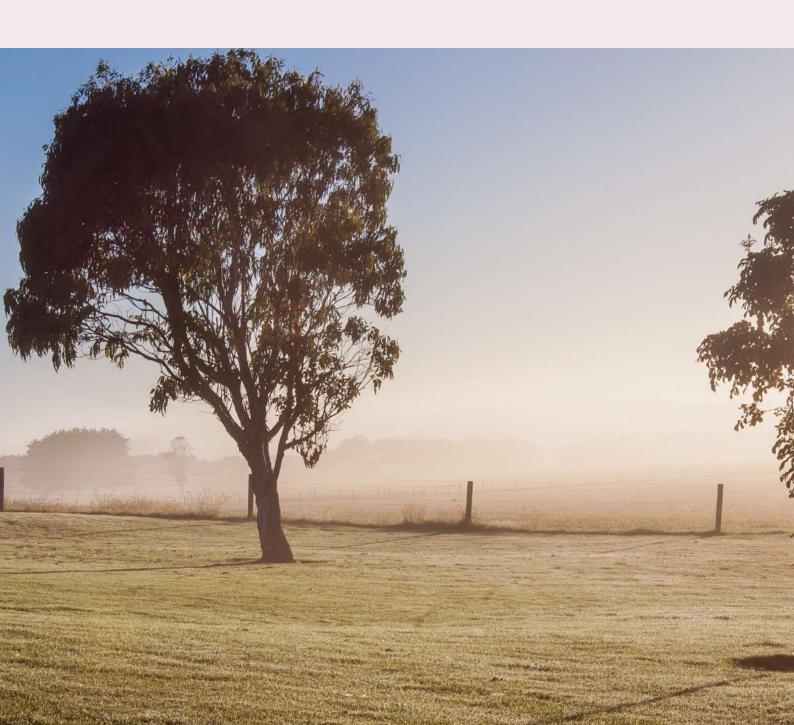

Maxi Concrete Tanks

Package includes (G.P.O, High Level Post, LED Light, Irrigation Pump & TFG Filter)

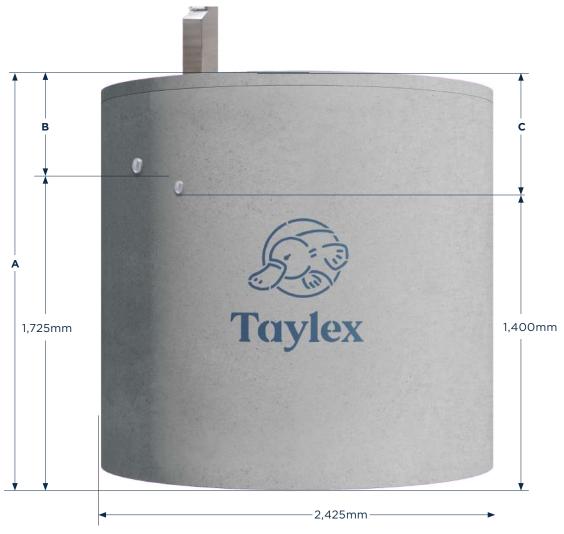

TANK SIZE	WEIGHT	A TOTAL HEIGHT OF TANK	B TOP OF TANK TO BOTTOM OF INLET	C TOP OF TANK TO BOTTOM OF OUTLET
STANDARD	6.25T	2,300mm	770mm	900mm
TALL 400	8T	2,700mm	1,170mm	1,300mm
TALL 600	8T	2,900mm	1,270mm	1,500mm

MAXI SEPTIC

MAXI-9M	With Package and 9m Head Pump
MAXI-26M	With Package and 26m Head Pump
MAXIGR	Gravity In - Gravity Out

*All Maxi Septic Models available in Tall 400 & 600 Models with 9M Head Pump, 26m Head Pump or Gravity In - Gravity Out

4,000L Septic Tanks

Package includes (Pump, LED Light, High Level Alarm Post with Float & TFG Filter)




4,000 SEPTIC - 3.5T (BAFFLE WALL MODEL 4T)

SEP4000STD	Tank and Lid Only
SEPBW4000STD	With Baffle Wall
SEPBWF4000	With Baffle Wall & TFG Outlet Filter
SEPBWSF4000	With Sealed Baffle Wall & TFG Filter
SEPBWSPA4000-9M	With Sealed Baffle Wall & Package and 9m Head Pump
SEPBWSPA4000-26M	With Sealed Baffle Wall & Package and 26m Head Pump

BW- 2 x 100mm Transfers 730mm From Base of Baffle Wall Sealed BW - 1 x 100mm Transfer 1580mm From Base of Baffle Wall

Taylex 8,100L Septic Tank

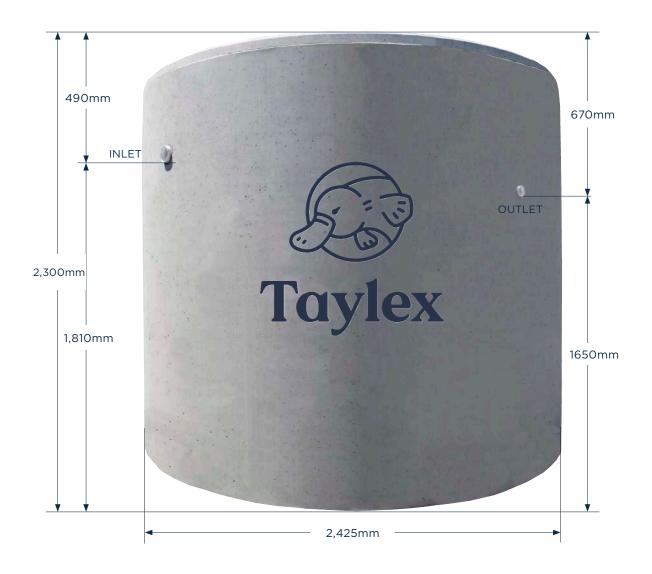


8,100L SEPTIC TANK - 5.6T

SEP8100STD

Septic Tank with Lid Only

Maxi Poly Tanks

Package includes (G.P.O, Highlevel Alarm Post, LED Light, Irrigation Pump & TFG Filter)

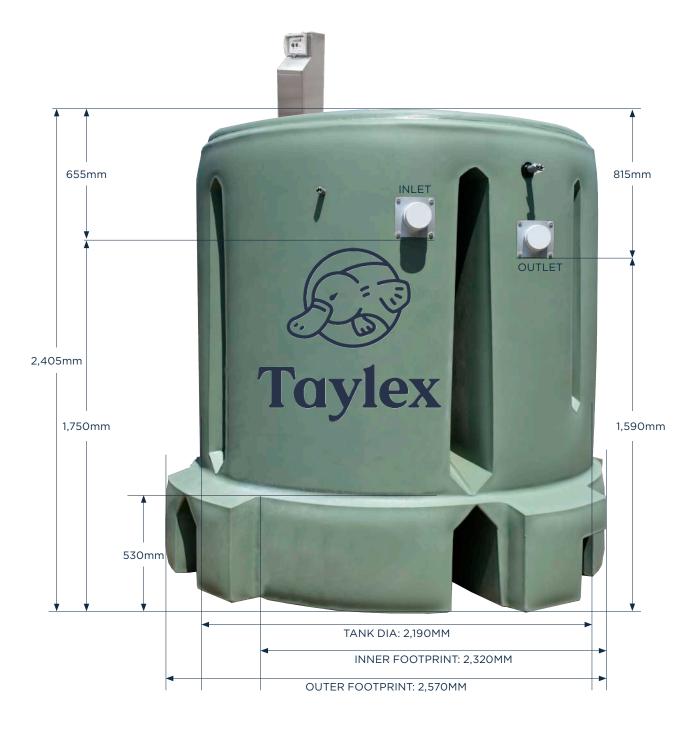

MAXI POLY SEPTIC - 600KG

PMAXI-9M	With Package and 9m Head Pump
PMAXI-26M	With Package and 26m Head Pump
PMAXG	Gravity In - Gravity Out


Pump Stations

Taylex Pump Stations are purpose built for wastewater and stormwater applications and highly flexible in design to cater to the specific requirements of your site.



Taylex 1,000L Pump Station

Package includes (G.P.O, Highlevel Alarm Post, LED Light & Pump)

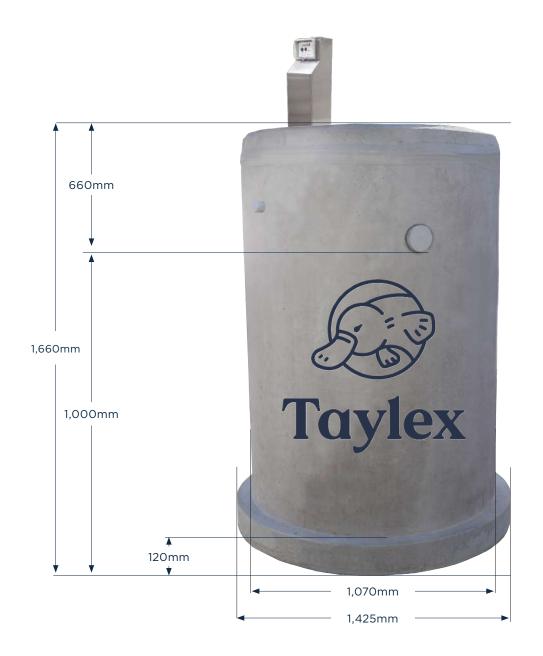

1,000L PUMP STATION - 3.5T

PP1000	Pump Station and Lid Only
PP1000-9M	Pump Station & Package with 9m Head Pump
PP1000-9M-COMP	Pump Station & Package with 9m Head Pump and Composite Access Covers
PP1000-26M	Pump Station & Package with 26m Head Pump
PP1000-26M-COMP	Pump Station & Package with 26m Head Pump and Composite Access Covers
PP1000-GRD	Pump Station & Package with 14m Head Grinder Pump
PP1000-GRD-COMP	Pump Station & Package with 14m Head Grinder Pump and Composite Access Covers

Concrete Rainwater Tanks



Taste the Taylex Difference

TAYLEX CONCRETE RAINWATER TANKS PROVIDE COOLER, CRISPER, CLEANER TASTING WATER.



Pedestrian traffic only. Not rated for Cars or Trucks

*Invert/Overflow Depth taken from Bottom of tank lid to the bottom of pipe.

PART NUMBER	TANK MODEL	DIAMETER (Ø)	HEIGHT (INCL LID)	TOTAL WEIGHT	INLET/ OVERFLOW DEPTH
RW10LSLSTD	10,000L	2,400mm (ø)	2,960mm	7.6T	450mm OR 550mm
RW22STD	22,500L	3,450mm (ø)	2,850mm	10T	150mm
RW31COMBO	31,500L	3,450mm (ø)	4,100mm	14.3T	250mm

Heavy Duty (HD) Tanks

HD=Light-Trafficable

Light trafficable lid. 2 tonnes point load. Car traffic only. Not rated for trucks.


*Invert/Overflow Depth taken from Bottom of tank lid to the bottom of pipe.

PART NUMBER	TANK MODEL	DIAMETER (Ø)	HEIGHT (INCL LID)	TOTAL WEIGHT	INLET/ OVERFLOW DEPTH
RW5HD	5,000L	2,470mm (ø)	1,875mm	7T	*Customisable
RW10LSQHD	10,000L SQUAT	2,750mm (ø)	2,540mm	7.8T	270mm OR 350mm OR 400mm
RW10LSLHD	10,000L SLIMLINE	2,400mm (ø)	3,030mm	7.8T	450mm OR 550mm
RW22HD	22,500L	3,450mm (ø)	2,900mm	11T	150mm

Heavy trafficable lid. 9 tonnes Wheel load. Car & Truck traffic.

*Invert/Overflow Depth can be customized to suit site requirements contact Taylex for more information.

PART NUMBER	TANK MODEL	DIAMETER (Ø)	HEIGHT (INCL LID)	TOTAL WEIGHT	INLET/ OVERFLOW DEPTH
RW5T44	5,000L	2,470 mm (ø)	1,875mm	7T	*Customisable
RW81T44	8,100L RECTANGLE	4,280mm (Length)	1,180mm (Width)	12.3T	*Customisable
RW10SQT44	10,000L SQUAT	2,750mm (ø)	2,565mm	8.3T	*Customisable
RW10SLT44	10,000L SLIMLINE	2,440mm (ø)	3,460mm	9.9T	*Customisable
RW22T44	22,500L	3,498mm (ø)	3,060mm	16.1T	*Customisable
RW31T44	32,000L	3,473mm (ø)	4,000mm	19.1T	*Customisable

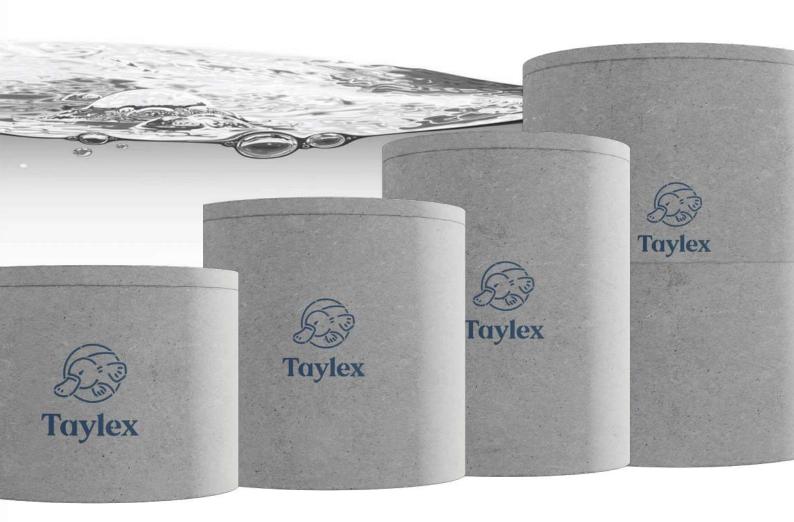

Concrete, Composite, Gatic Access Covers & Risers




Round - Concrete Access Covers

ABS/COMPACT ROUND ACCESS COVER - 25KG

To suit Riser with Screen (RRW-SCREEN)

4,000L PLAIN SEPTIC ACCESS COVER - 30KG






RLC ABS Compact Access Cover

RLSEP


4,000L Plain Septic Access Cover

Eliptical Access Covers

COMPACT - 50KG

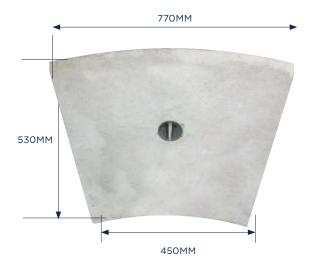


VICTORIAN - 50KG

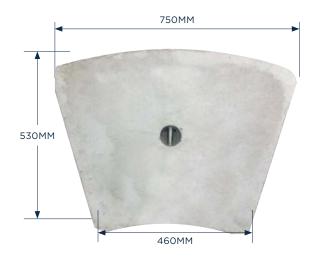

RLCEL Compact Eliptical Access Cover

RLCELV Victorian Eliptical Access Cover

Round Risers

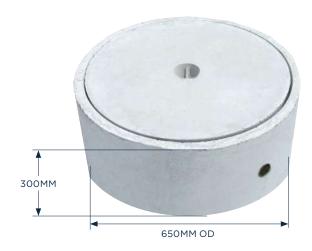

ABS/COMPACT RISER - 55KG

Lid not included, for illustration purposes only.

RRABS300

Round Riser for Compact/ABS


RRSETABS

Set of 4 Risers

Riser with Gatic Access Cover


150MM RAINWATER TANK RISER WITH CLASS B GATIC ACCESS COVER - 60KG

For Sewer and Stormwater

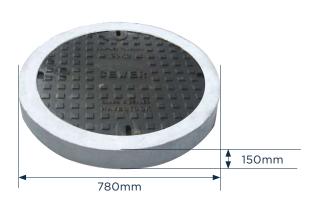

450MM RAINWATER TANK RISER WITH CLASS B GATIC ACCESS COVER - 100KG

For Sewer and Stormwater

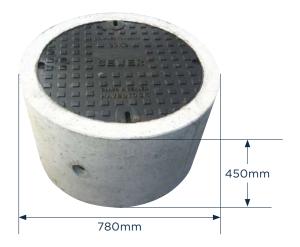

RWR150GA

150mm Riser with Gatic Access Cover

RWR450GA

450mm Riser with Gatic Access Cover

Rainwater - Concrete Access Covers + Risers


CONCRETE ACCESS COVER ONLY - 20KG

To suit 22,000L and 31,500L



150MM RAINWATER TANK RISER - 60KG

To suit 22,000L and 31,500L

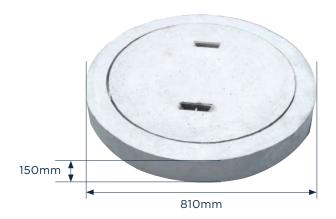


RW22/31MANHOLELID

Concrete Access Cover For Rainwater Tanks

RWR150 150mm Riser

RISER WITH SCREEN AND PUMP LINE 100MM - 47KG

Suitable for STD and HD Rainwater Tanks

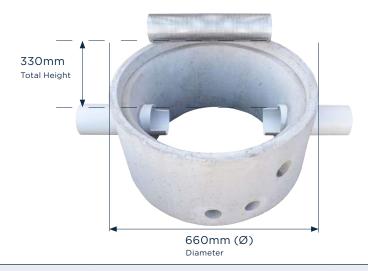

RRW-SCREEN

Riser with Screen & Pump Lines

Composite & Gatic Access Covers

450MM ROUND COMPOSITE ACCESS COVER

CLASS B - 11KG



600MM ROUND COMPOSITE ACCESS COVER **CLASS B - 15.8KG**



GATIC INFILL ACCESS COVER CLASS D - 40 KG



600MM SQUARE COMPOSITE ACCESS COVER CLASS B - 22.2KG



600MM X 900MM RECTANGULAR COMPOSITE ACCESS COVER CLASS B - 25KG



GATIC ACCESS COVER CLASS D - 40 KG



COMP45B	450mm Round Composite Access Cover
COMP6X6	600mm Square Composite Frame and Cover
COMP600ROUND	600mm Round Composite Access Cover
COMP6X9	600mm x 900mm Composite Frame and Cover
GL60DI	600mm Round Class D Gatic Infill Access Cover
GL60DSW	600mm Round Class D Gatic Access Cover

Hole Coring, Fittings & Anti-Flotation



Brass Fittings



BF32	32mm Brass Fitting only	
BFF32	32mm Brass Fitting - Fitted	
BF50	50mm Brass Fitting only	
BFF50	50mm Brass Fitting - Fitted	
BF80	80mm Brass Fitting only	
BFF80	80mm Brass Fitting - Fitted	
BF100	100mm Brass Fitting only	
BFF100	100mm Brass Fitting - Fitted	

Hole Coring for Rainwater Tanks



HOLE CORING FOR W80 RAINWATER TANKS

HOLECORE-SML	32mm - 250mm
HOLECORE-LGE	300mm - 500mm

Anti-Flotation

ANTI-FLOTATION - BARS AND HOLES



AF10	5,000L & 10,000L
AF15	15,000L
AF22/31	22,500L + 31,500L

ANTI-FLOTATION - CONCRETE FOOT (COMPLETE) - 100KG



AFF4 4,000L with Complete Anti-flotation

ANTI-FLOTATION - CONCRETE FEET (COMPLETE) - 500KG



AFF10 - 5,000L & 10,000L SLIMLINE




AFF10 - 10,000L SQUAT

AFF10

5,000L, 8,100L & 10,000L Slim/Squat with Anti-flotation

Electrical Equipment

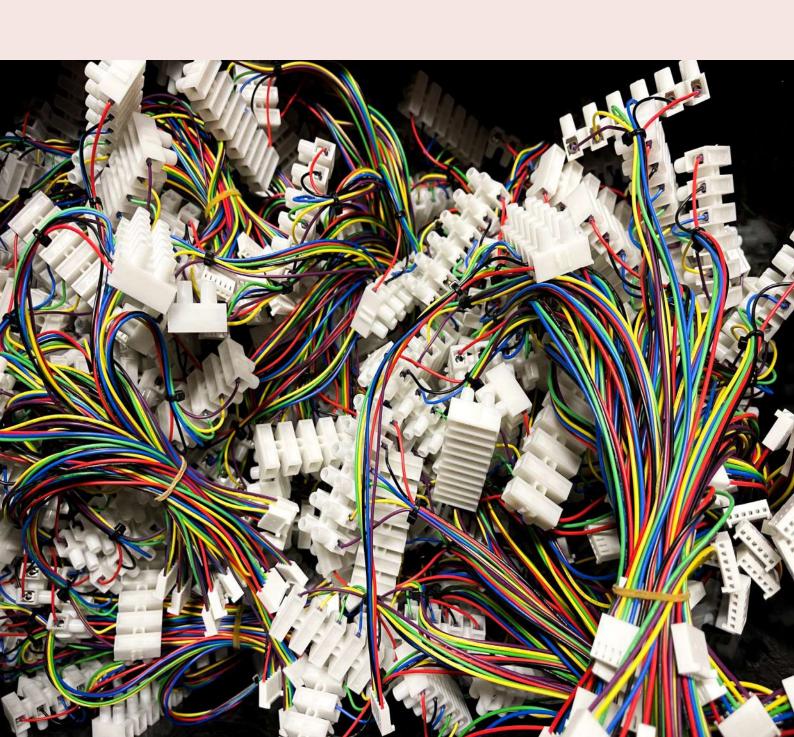

Control Panels

ABS ECO 2 CONTROL PANEL



ABS ECO TRANSFER PUMP CONTROL PANEL



PANEL-TPC-ECO

ABS Eco Control Panel - 12V

ABS Eco Transfer Pump Control Panel - 12V

PANELABS2 ABS Control Panel (no Circuit Breaker) - 240V

Wiring

DELUXE
WIRING LOOM













LOOM Compact/ABS Wiring Loom for Control Panel

LOOMDEL Deluxe Wiring Loom for Deluxe Control Panel

LOOM-ECO Eco Wiring Loom for Eco Control Panel

AIRASSY-ABS Air Switch Assembly

Packages





ECO PACKAGE

- 1. Control Panel Box
- 2. ABS Eco Control Panel
- 3. ABS System ID Plate
- 4. Air Switch Assembly
- 5. GPO Assembly
- 6. Blower Box

ECO-COMP-PACKAGE

Eco Package with ECO Control Panel

ABSIDPLATE

ABS System ID Plate

Other Equipment



BLOWER BOX FOR ABS


BLBOXB (BLUE)

BLBOXG (GREEN)



RED LED LIGHT

LED

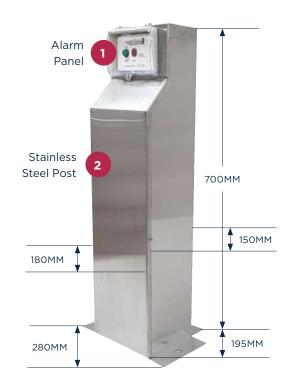

HIGH WATER LEVEL ALARM CONTROL BOX

HLAPS-ECO

HIGH LEVEL FLOAT SWITCH

CMG AERATOR

CAPACITOR FOR AERATOR







FLOAT - 3M	High Level Float Switch 3m	
FLOAT - 5m	High Level Float Switch 5m	
AFRMOT	CMG Aerator - Bare with 12 month warranty	

AERCAP Capacitor for Aerator


Next Generation Control Panel

Modem Battery Ready

ABS ECO 2 CONTROLLER



- 1. ABS Eco Control Panel
- 2. Upgrade Chip
- 3. GPS Antenna
- 4. Modem (Not Included)
- 5. Battery Back up
- 6. Eco Wiring Loom

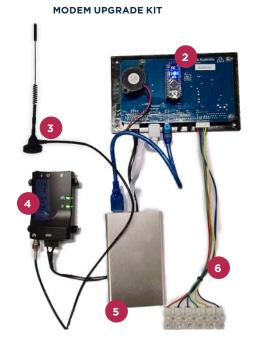

ABSECO-BAT-KIT

Upgrade Kit (Excluding Modem)

Modem & Battery

ABS BACK TO BASE ALARM MODEM



TO BE INSTALLED BY USER)

BACK UP BATTERY



ABS-MODEM

ABS Back To Base Alarm Modem

ABS-BATTERY

Back Up Battery
(for use with Back to Base Alarm Modem)

Pumps



Davey Irrigation Pumps

D25



D42A/B-3





DAV25A	D25 Irrigation Pump Not suitable for Sub Surface Irrigation - 9m Head
DAV42AB3	D42A/B-3 Irrigation Pump Suitable for Sub Surface Irrigation - 32m Head
DAV53A	D53A Irrigation Pump Suitable for Sub Surface Irrigation - 45m Head

*Bulk Buy discounts available, see Price table for details

Davey Sludge Pumps





DAV15VA	D15VA Sludge Pump - Deluxe
DAV25VA	D25VA Sludge Pump - 6.5m Head
DAV40VA	D40VA Sludge Pump Suitable for Sub Surface Irrigation - 32m Head

Davey Grinder Pumps





DAV75GA	D75GA Grinder Pump
	Single Phase - 38m Head

DAV120GA D120GA Grinder Pump
Single Phase - 38m Head

Grundfos Pumps









GRU-APG40-10	Grundfos Grinder Pump with Float
GRU-KP150A	Grundfos Unilift KP150-A 5m PUMP
GRU-SBA3-45	Grundfos Rainwater Tank Pump

Grundfos Controllers (To Suit Grinder Pump - APG40-10)

GRU-LC231-1X



GRU-LC231-2X



GRU-LEVEK-TRO-5M



GRU-LC231-1X	Grundfos Single Pump Duty Cycle Controller
GRU-LC231-2X	Grundfos Dual Pump Duty Cycle Controller
GRU-LEVEK-TRO-5M	Grundfos Level Transmitter 5m

Piston Blowers, Diffusers & Blower Retro Kits



Nitto 80L Blower (ABS)

For Taylex Advanced Blower Systems. Complete with 3 year warranty.



BL80	Nitto LA80B Blower
BL80HOSE-ST	Straight Hose Assembly for LA80B
BL80HOSE-ELB	Elbow Assembly for LA80B

*Bulk Buy discounts available, see Price table for details

Nitto 80L Blower (ABS) - Retro Fit Kit

To replace the Aerator. Comes with 7" Diffuser.



BL80-ECO-RETRO

Retro Eco Controller, Blower and Blower Box

Nitto 120L Blower

Complete with 3 year warranty.



BL120 Nitto LA120A Blower

BL120HOSE-ELB

Elbow Assembly for LA120A

Nitto 200L Blower

Complete with 3 year warranty.



BL200 Nitto LAM200 Blower

Back Pressure Gauge

Back Pressure Kit TBC





BACKGAUGE-ASSY Back Pressure Gauge

BACKGAUGE-DIG Digital Back Pressure Gauge

Nitto Blower Piston Kit



BLPIS80	To suit BL80 Blower
BLPIS120	To suit BL120 Blower
BLPIS200	To suit BL200 Blower

Filters for Nitto Blower

To be replaced every 6 months.



BLF80	To suit BL80 Blower (Sold in multiples of 20)
BLF120	To suit BL120 Blower (Sold in multiples of 10)
BLF200	To suit BL200 Blower (Sold in multiples of 10)

Diffuser for ABS 7" & 9" Plastic Slab for Retro's





DIFF7	7" - Diffuser
DIFF9	9" - Diffuser

SLAB	Plastic Slab for Retros

Filters



Taylex Filter Septic – TFS

Price each.



TFS Taylex Filter Septic - White

TFROD

Filter Rod (Nylon Rod) with SS Nut

Taylex Filter Grease – TFG

Price each.



TFG Taylex Filter Grease - Green

TFROD Filter Rod (Nylon Rod) with SS Nut

TFS & TFG Reducing Cone



TFRED

TFS & TFG Reducing Cone


Taylex Filter Residential – TFR



TFR

Taylex Filter Residential - TFR

Irrigation

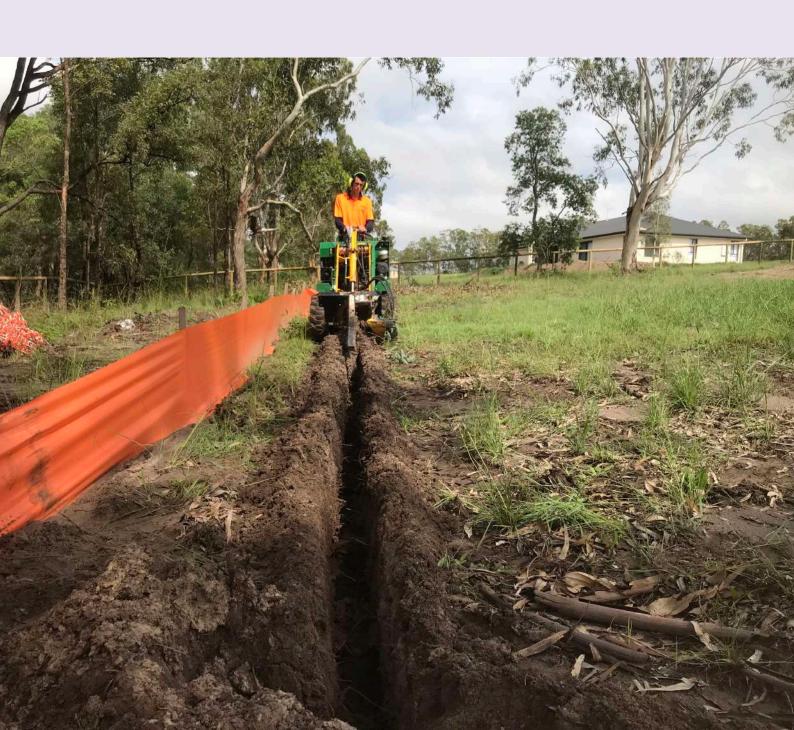

Poly Pipe-25mm

Lilac strip 50m roll









TURFVALVE

Turf Valve Key





TURFVALVEKEY



TVELB

Poly Elbow

1" x 25



ELB2525

Joiner-25mm



COUPMET25-25

Outer Tank Fitting

1" x 32



SOCKM25

Fl Poly Tee

1" x 25



TEE2525

LD Poly Tee

19mm x 3/4



SPRINKT

LD Poly Director

19mm x 3/4



SPRINKDIR

Ratchet Clamp



CLAMPRAT

Valve



QUICKVALVE

Dome Sprinkler

Sullage Hose – 19mm

100m roll





DOMESP

HOSE19100

Wobbler Tee Complete

With Base



Top Only





WOBTB

WOBTOP

Recycled Water Warning



SIGNRW

Recycled Water Warning Sign

K Rain Valve

Available in 2, 3, 4 and 6





KRAIN2	K Rain Valve 2
KRAIN3	K Rain Valve 3
KRAIN4	K Rain Valve 4
KRAIN6	K Rain Valve 6

120 Micron

MESH FILTER REPLACEMENT



MESH FILTER COMPLETE - 40MM



DISC REPLACEMENT



DISC FILTER COMPLETE



120MICRONMESH	Mesh Filter Replacement
120MICRONDISC	Disc Replacement
FILTMESH120	Mesh Filter Complete - 40mm

120MICRONDISCFILTER

Disc Filter Complete

Servicing



Service Perpetual Contract Book

Taylex ABS & Compact. 50 contracts per book.

		Taylex Accredited Service Agent's Details
Tax	lov	
K 3 Tuy	IEX	
WASTE	WATER	
SERVIC	ING	
Service Contract	for your Tayle	ex Sewage Treatment System
Owners Name		
Property Address		
Dear Home Owner,		
Upon acceptance of this application a	duly authorised Taylex Accre	edited Service Agent (TASA), will supply the following:
Quarterly field service inspections wi	II be made by a factory train	ed service person.
Inspections include:		
(a) Any adjustment, cleaning (excludin	g de-sludging) and field serv	rice of the unit necessary for proper operation.
		blower or aerator, shaft, aspirator and vent, bio-mass, recycle np, sprinkler lines and heads, and float alarm (where fitted).
Preparation and lodgement of all rel responses to council inspections if requ		ns in relation to commissioning and upon every service,
Taylex Systems built after 2013 com- current, continual service contract, and		m commissioning date, on parts for customers with a paid, tank.
An emergency breakdown service is labour and materials will be applied for		verbal response within 24 hours Mon to Fri, a callout fee, re is caused by parts under warranty.
	cations, these repairs will be o	uring the warranty period, due to damage which has charged to you the homeowner, to include a callout and/ or warranty period on the system.
Any items replaced will be left on site,	disposal of these items are th	ne home owners responsibility.
6. All repairs are on a strictly C.O.D. bas	sis.	
7. This agreement does not bind the TA	ASA to be responsible for the	quality of the effluent.
		e effluent quality can be maintained at its maximum and alter o obtain the best possible effluent standards.
8. TASA's require clear access on site a complete the scheduled service due w		epeated attempts to access the system in order to
	etual contract, thereafter, e	oning of Sewage system and 3 quarterly services as part of ach year, an invoice will be issued for the continuance of ments.
In applying for this agreement, the undersigned acknowledges that this Agreement is binding while they are owner of the premises. In the event of ownership of the property changing hands, any remaining services due on this contract will be honoured to the new owners, the exchange of monies for these services should be taken up as part of the property settlement.		
Cancellation of this contract will be accepted upon receipt of a written cancellation advice.		
C:		

BKCONT

50 Contracts Per Book

Service Report Book

Taylex ABS & Compact.

Your Authorised Agent serviced and inspected your Waste Water Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests N/A Inp Inlet primary baffie cleaned Free Residual Chlorine Outlet filter cleaned PH I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Iets Added: Clarity from Irrigation Chamber mm Temp o	Your Authorised Agent serviced and inspected your Waste Water Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests	Inspected your Waste Water esults are as follows: Yes No N/A Tests N/A	Name (Owner/Occupier) Local Council ID Number
Your Authorised Agent serviced and inspected your Waste Water Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests N/A Inp Inlet primary baffie cleaned Free Residual Chlorine Outlet filter cleaned PH I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Iets Added: Clarity from Irrigation Chamber mm Temp o	Your Authorised Agent serviced and inspected your Waste Water Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests	Inspected your Waste Water esults are as follows: Yes No N/A Tests N/A	Site Address Municipality or Shire
Your Authorised Agent serviced and inspected your Waste Water Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests N/A Inlet primary baffle cleaned Pree Residual Chlorine Outlet filter cleaned Dissolved Oxygen I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Interpretation Clarity from Irrigation Chamber mm Temp O	Your Authorised Agent serviced and inspected your Waste Water Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests	Inspected your Waste Water esults are as follows: Yes No N/A Tests N/A	Municipality or Shire
Your Authorised Agent serviced and inspected your Waste Water Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests N/A Inlet primary baffle cleaned Dissolved Oxygen I dedvice Aerator filter cleaned PH I Audible Primary Sludge mm I Visual Secondary Sludge mm Infection Lets Added: Clarity from Irrigation Chamber mm Temp O RESPONDED AREA:	Your Authorised Agent serviced and inspected your Waste Water Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests	Inspected your Waste Water esults are as follows: Yes No N/A Tests N/A	System Type
Your Authorised Agent serviced and inspected your Waste Water Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests N/A	Your Authorised Agent serviced and inspected your Waste Water Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests	Inspected your Waste Water esuits are as follows: Yes No N/A Tests N/A N/A	
Treatment Plant today. The results are as follows: Pass Fail N/A Yes No N/A Tests N/A Inp	Pass Fail N/A Yes No N/A Tests	Yes No N/A Tests N/A	Volus Authorized Agent condeed and Inspected years Waste Water
Pass Fail N/A Yes No N/A Tests N/A Inlet primary baffle cleaned Dissolved Oxygen I dedevice Aerator filter cleaned PH I Visual Secondary Sludge mm INFECTION Aeration Sludge mm I clarity from Irrigation Chamber Temp o	Pass Fail N/A Yes No N/A Tests	Yes No N/A Tests N/A	
Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen le device Aerator filter cleaned PH I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Intrigation Chamber mm I Temp o			reatment Plant today. I ne results are as follows:
le device Aerator filter cleaned PH Primary Sludge mm Secondary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from Irrigation Chamber mm Temp o	inlet primary barrie cleaned Free Residual Chlorine	- I Too Nooledan Chilornic	Dags Fail N/A Vos No N/A Tosts N/
I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm Temp o	erator Outlet filter cleaned Dissolved Oxygen	Dissolved Oxvaen	
I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Iets Added: Clarity from Irrigation Chamber mm Temp o	udge recycle device Aerator filter cleaned PH		rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine
INFECTION Aeration Sludge mm Idets Added: Clarity from Irrigation Chamber mm Temp o	ontrol Panel Audible Primary Sludge mr		rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen
lets Added: Clarity from Irrigation Chamber Temp O		РН	rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH
Temp o	ontrol Panel Visual Secondary Sludge mr	PH Primary Sludge mm	rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm
Temp o		PH Primary Sludge mm Secondary Sludge mm	rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Secondary Sludge mm
	INAL DISINFECTION Aeration Sludge mr	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
OK VIII OK VII	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
25 & Sprinklers: OK Yes / No Ponding: Yes / No Run Off: Yes / No	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp cone	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
rrigation filter cleaned: Yes / No Root Inhibitor added: Yes / No Flush Lines: Yes / No	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn Itra Violet Temp zone SPOSAL/GARDENBEDAREA:	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber o	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm Chlorine Tablets Added: Clarity from mm Ditra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr Indication Tablets Added: Clarity from Irrigation Chamber mn Itra Violet Temp Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber o Temp o Run Off: Yes / No	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm Chlorine Tablets Added: Clarity from mm Inlet primary baffle cleaned PH Primary Sludge mm Aeration Sludge mm Chlorine Tablets Added: Clarity from mm Irrigation Chamber mm Ozone Disposal/Gardenbed Area: OK Yes / No Ponding: Yes / No Run Off: Yes / No
ALTERING OF IRRIGATION AREA WILL VOID ALL WARRANTY	INAL DISINFECTION Aeration Sludge mr Informe Tablets Added: Clarity from Irrigation Chamber mn Itra Violet Temp Image: Temp Temp Temp Image: Temp Temp Temp Image: Temp Temp Temp Image: Temp Temp Temp Temp Temp Temp Temp Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber o Temp o So / No Run Off: Yes / No radded: Yes / No Flush Lines: Yes / No	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Dissolved Oxygen Aerator Filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber Temp o Ozone Temp Oxygen OXYGEN PANEL PROPOSAL/GARDENBED AREA: Prigation Lines & Sprinklers: OK Yes / No Ponding: Yes / No Run Off: Yes / No Flush Lines: Yes /
	INAL DISINFECTION Aeration Sludge mr Indication Tablets Added: Clarity from Irrigation Chamber mn Itra Violet Temp SPOSAL/GARDENBEDAREA: rigation Lines & Sprinklers: OK Yes / No Ponding: Yes / No Root Inhibitor added: Yes / No Flush Lines: Yes / No ALTERING OF IRRIGATION AREA WILL VOID ALL WARRANTY	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber o Temp o Run Off: Yes / No radded: Yes / No Flush Lines: Yes / No WILL VOID ALL WARRANTY	Inlet primary baffle cleaned Free Residual Chlorine Dissolved Oxygen Dissolved Oxygen Dissolved Oxygen PH Primary Sludge mm Control Panel Audible Control Panel Visual Secondary Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber Dissolved Oxygen Meration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber Temp Oxone Dissolved Oxygen Meration Sludge mm Clarity from Irrigation Chamber Temp Oxone Dissolved Oxygen Meration Sludge mm Clarity from Irrigation Chamber Temp Oxone Dissolved Oxygen Meration Sludge mm Clarity from Irrigation Chamber Temp Oxone Dissolved Oxygen Meration Sludge mm Clarity from Irrigation Chamber Meration Sludge mm Meration Sludge mm Clarity from Irrigation Chamber Meration Sludge mm Meration Sludge mm Acration Sludge mm Clarity from Irrigation Chamber Meration Sludge mm Meration Sludge mm
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn Itra Violet Temp SPOSAL/GARDENBEDAREA: rrigation Lines & Sprinklers: OK Yes / No Ponding: Yes / No Run Off: Yes / No Lub surface irrigation filter cleaned: Yes / No Root Inhibitor added: Yes / No Flush Lines: Yes / No ALTERING OF IRRIGATION AREA WILL VOID ALL WARRANTY omments.	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber o Temp o So / No Run Off: Yes / No radded: Yes / No Flush Lines: Yes / No WILL VOID ALL WARRANTY	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Dissolved Oxygen Aerator Filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Othlorine Tablets Added: Temp o Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Slu
	INAL DISINFECTION Aeration Sludge Clarity from Irrigation Chamber	PH Primary Sludge Secondary Sludge Aeration Sludge Clarity from Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge Control Panel Visual Secondary Sludge FINAL DISINFECTION Aeration Sludge Chlorine Tablets Added: Clarity from Irrigation Chamber
	INAL DISINFECTION Aeration Sludge mr Informe Tablets Added: Clarity from Irrigation Chamber mn Itra Violet Temp Image: Temp Temp Temp Image: Temp Temp Temp Image: Temp Temp Temp Image: Temp Temp Temp Temp Temp Temp Temp Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber o Temp o 8 / No Run Off: Yes / No radded: Yes / No Flush Lines: Yes / No	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Dissolved Oxygen Aerator Filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber Temp o Ozone Temp Oxygen OXYGEN PANEL PROPOSAL/GARDENBED AREA: Prigation Lines & Sprinklers: OK Yes / No Ponding: Yes / No Run Off: Yes / No Flush Lines: Yes /
ALTERING OF IRRIGATION AREA WILL VOID ALL WARRANTY	INAL DISINFECTION Aeration Sludge mr Informe Tablets Added: Clarity from Irrigation Chamber mn Itra Violet Temp Image: Temp Temp Temp Image: Temp Temp Temp Image: Temp Temp Temp Image: Temp Temp Temp Temp Temp Temp Temp Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber o Temp o 8 / No Run Off: Yes / No radded: Yes / No Flush Lines: Yes / No	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Dissolved Oxygen Aerator Filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber Temp o Ozone Temp Oxygen OXYGEN PANEL PROPOSAL/GARDENBED AREA: Prigation Lines & Sprinklers: OK Yes / No Ponding: Yes / No Run Off: Yes / No Flush Lines: Yes /
ALTERING OF IRRIGATION AREA WILL VOID ALL WARRANTY	INAL DISINFECTION Aeration Sludge mr Informe Tablets Added: Clarity from Irrigation Chamber mn Itra Violet Temp Image: Temp Temp Temp Image: Temp Temp Temp Image: Temp Temp Temp Image: Temp Temp Temp Temp Temp Temp Temp Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber o Temp o So / No Run Off: Yes / No radded: Yes / No Flush Lines: Yes / No	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Dissolved Oxygen Aerator Filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber Temp o Ozone Temp Oxygen OXYGEN PANEL PROPOSAL/GARDENBED AREA: Prigation Lines & Sprinklers: OK Yes / No Ponding: Yes / No Run Off: Yes / No Flush Lines: Yes /
	INAL DISINFECTION Aeration Sludge mr Indication Tablets Added: Clarity from Irrigation Chamber mn Itra Violet Temp SPOSAL/GARDENBEDAREA: rigation Lines & Sprinklers: OK Yes / No Ponding: Yes / No Root Inhibitor added: Yes / No Flush Lines: Yes / No ALTERING OF IRRIGATION AREA WILL VOID ALL WARRANTY	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber o Temp o Run Off: Yes / No radded: Yes / No Flush Lines: Yes / No WILL VOID ALL WARRANTY	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Dissolved Oxygen Aerator Filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Othlorine Tablets Added: Temp o Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Sludge mm Clarity from Irrigation Chamber mm Dissolved Oxygen Maration Slu
	INAL DISINFECTION Aeration Sludge mr Indication Tablets Added: Clarity from Irrigation Chamber mn Itra Violet Temp Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber o Temp o Run Off: Yes / No	Inlet primary baffle cleaned Free Residual Chlorine erator Outlet filter cleaned Dissolved Oxygen ludge recycle device Aerator filter cleaned PH ontrol Panel Audible Primary Sludge mm INAL DISINFECTION Aeration Sludge mm Iltra Violet Clarity from Irrigation Chamber mm Itra Violet Temp o SPOSAL/GARDENBEDAREA: rigation Lines & Sprinklers: OK Yes / No Ponding: Yes / No Run Off: Yes / No
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Aerator Outlet filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
OK Viv. (No. 19 No. 19	DISINFECTION Aeration Sludge mr Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Pump Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen ecycle device Aerator filter cleaned PH Panel Audible Primary Sludge mm Panel Visual Secondary Sludge mm Tablets Added: Clarity from Irrigation Chamber mm
ON Ver Alle Bull Ver Alle	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp cone	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber Irrigation Chamber Temp o
OV Visit No. 12	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
OK Viv. (No. 1)	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber mm	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber mm	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber mm	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber mm	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber mm	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber Temp	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber mm	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from Irrigation Chamber mm Jitra Violet Temp o
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
	INAL DISINFECTION Aeration Sludge mr hlorine Tablets Added: Clarity from Irrigation Chamber mn	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm Irrigation Chamber	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm
	INAL DISINFECTION Aeration Sludge mr	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm Clarity from mm	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Control Panel Visual Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm Chlorine Tablets Added: Clarity from
RDENBED AREA:	INAL DISINFECTION Aeration Sludge mr	PH Primary Sludge mm Secondary Sludge mm Aeration Sludge mm	Inlet primary baffle cleaned Free Residual Chlorine Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Secondary Sludge mm FINAL DISINFECTION Aeration Sludge mm
Temp o		PH Primary Sludge mm Secondary Sludge mm	rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm Secondary Sludge mm
Temp o	ontrol Panel Visual Secondary Sludge mr	PH Primary Sludge mm	rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm
lets Added: Clarity from Irrigation Chamber Temp o	1000	PH Primary Sludge mm	rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH Control Panel Audible Primary Sludge mm
INFECTION Aeration Sludge mm lets Added: Clarity from Irrigation Chamber mm Temp o		PH	rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH
INFECTION Aeration Sludge mm Icts Added: Clarity from Irrigation Chamber mm Temp o	ontrol Panel Audible Primary Sludge mr	PH	rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen Sludge recycle device Aerator filter cleaned PH
INFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm Temp o	ontrol Panel Audible Primary Sludge mr		rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen
I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Iets Added: Clarity from Irrigation Chamber mm Temp o			rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine Aerator Outlet filter cleaned Dissolved Oxygen
I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Clarity from Irrigation Chamber mm Temp o			rrigation Pump Inlet primary baffle cleaned Free Residual Chlorine
le device Aerator filter cleaned PH Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Iets Added: Clarity from Irrigation Chamber mm Temp o	erator Outlet filter cleaned Dissolved Oxygen	Dissolved Oxvaen	
le device Aerator filter cleaned PH Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Iets Added: Clarity from Irrigation Chamber mm Temp o	inlet primary battle cleaned Free Residual Chlorine	- 1 Too Noosadar Onionnic	Pass Fail N/A Yes No N/A Tests N/
I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Idets Added: Clarity from Irrigation Chamber mm Temp o			Pass Fail N/A Yes No N/A Tests
Outlet filter cleaned Dissolved Oxygen le device Aerator filter cleaned PH I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Clarity from lrrigation Chamber mm Temp o	tion Duran	d Free Residual Chlorine	
Outlet filter cleaned Dissolved Oxygen le device Aerator filter cleaned PH I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Lets Added: Clarity from Irrigation Chamber mm Temp o	iniet primary barrie cleaned Free Residual Chlorine		Pass Fail N/A Yes No N/A Tests N/
Outlet filter cleaned Dissolved Oxygen le device Aerator filter cleaned PH I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Lets Added: Clarity from lrrigation Chamber mm Temp o	viscation Duran	d Free Residual Chlorine	
Outlet filter cleaned Dissolved Oxygen le device Aerator filter cleaned PH I Audible Primary Sludge mm I Visual Secondary Sludge mm INFECTION Aeration Sludge mm Clarity from mm Irrigation Chamber mm Temp o	direction Duran	d Free Residual Chlorine	<u> </u>

BKFSR

ABS & Compact Service Book

Air Cock



AIRCOCK

Chlorine Tube

For ABS, Compact and Deluxe.



CHLTUBE

Chlorine Tube

25kg Chlorine Drum



CHLDR

Filter Sock



FILTER SOCK

Barrel

Non-Return Valve



BARRUNNR

Chlorine PH Test Strips

50 strips per bottle.



CHLTEST

Taylex | PRODUCT CATALOGUE V1.1

Slow Blow Fuse

For ABS, Compact and Deluxe.



FUSE5 (5 AMP)

Tool Box

Complete with Test Plugs and Compressor.



BOXCOMPLUG

Sika Flex 600ml Tube



SIKATUBE

Service Kit + Parts



SLUJU-25

BBRUSH-ASSY

SVC-KIT (SLUJU-25 + BRUSH-ASSY)

Dissolved Oxygen Meter

VIALS



DOVIALS

KIT



DOKIT

Servicing Documents (QR Codes)





SERVICING PROCEDURE ABS




Scan Here for Servicing Procedure ABS

SERVICING PROCEDURE +P FILTER



Scan Here for Servicing Procedure +P Filter



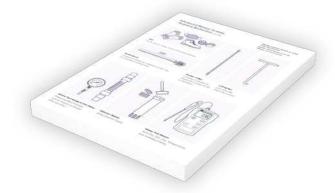

SERVICING CARD



Scan Here for Servicing Card

SERVICING TOOLS KIT




Scan Here for Servicing Tools Kit


Sales Support Material




QR Codes for Catalogues

Wastewater Materials

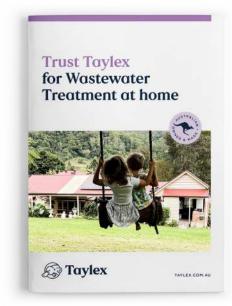

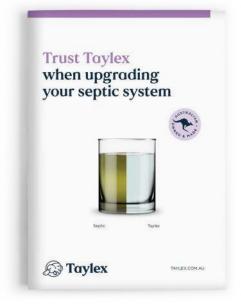

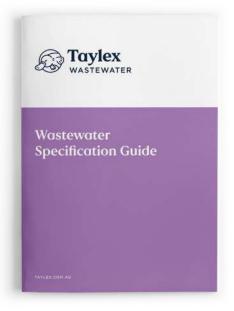



Scan Here for Homeowners Guide




Scan Here for Septic Upgrade



Scan Here for Wastewater Specification Guide







Scan Here for Owner's Manual

Rainwater Materials





Scan Here forRainwater HomeownersGuide





Scan Here for Rainwater Specification Guide

Unique Selling Point (USP) A2 Posters



ONLY PAY POSTAGE*

USP POSTER BUNDLE

Uniforms

TAYLEX CO BRANDED POLO SHIRTS



TAYLEX CO BRANDED HI VIS





TAYLEX BUCKET HAT





Visit our uniform portal for further information.

Username: orders@taylex.com.au

Password: Taylexdist

Co-Branded Signage

Work with us to customise signage featuring Your Logo.

WASTEWATER SPECIALIST SITE SIGN - CORFLUTE 600MM X 600MM



FENCE/SHED SIGN - ARTWORK ONLY 1,000MM X 745MM



ARTWORK ONLY*

SIGNSITE	Distributor Site Sign - Corflute 600mm x 600mm
SIGNSHED	Metal Shed Sign - Artwork Only 1,000mm x 750mm

Please Note: Personalised artwork can be supplied by Taylex free of charge. Taylex can assist in sourcing prints if required, however, the cost of print is chargeable.

Vehicle Wrap

DUAL CAB UTE VEHICLE WRAP EXAMPLE

Standard: 2 x Sides, Front and Back, plus Distributor details



SERVICE VAN VEHICLE WRAP EXAMPLE

Standard: 2 x Sides, Front and Back, plus Distributor details



Work with us to customize the design featuring your branding.


Specialist 'Billboard'



We offer our specialist the opportunity to implement an effective advertising strategy, by using a real Taylex Tank wrapped with their company details.

Taylex will supply the display banners with your contact details free of charge and display tanks when it is reasonable/cost effective to do so. Freight will be the only cost incurred however, if you get 2 Billboards, we will cover the freight cost for one.

Website Development

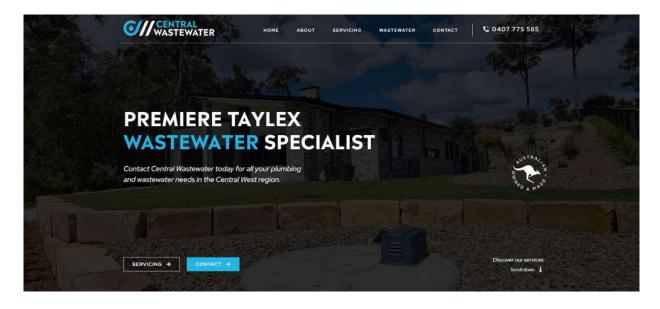

We work closely with our internal web developer to put together a strong, simple and cost - efficient website template for our Specialists to use.

Acronym List

ABS Advanced Blower System

ABSNR Advanced Blower System with Nutriet Reduction

PABS Poly Advanced Blower System

PABSNR Poly Advanced Blower System with Nutriet Reduction

+P Filter Phospherous Removal Filter

TSS Total Suspended Solids

BOD Biochemical Oxyden Demand

TFC Taylex Filter Control

TFS Taylex Filter Septic

TFG Taylex Filter Grease

G.P.O General Power Outlet

LED Light Emitting Diode

STD Standard

RW Rainwater

OD Outer Diameter

AFF Anti-Flotation Feet

HLAP High Level Alarm Post

TBC To Be Confirmed

LD Low Density

PH Potential Hydrogen

QR Quick Response



